


## Before Installation

Please read these instructions carefully and keep for future reference.

The information in this document is subject to change without notice. For updates please refer to our website.




Do not use the products outside the rated power supply voltage range specified in the Specifications. It may cause a fire or damage to equipment.

---



Do not disassemble, repair, or modify the products. It may cause a fire or electric shock.

---



Make sure to turn the power off before commencing any wiring work. Otherwise it may cause electric shock or damage to equipment.

---

**Note:** Follow the requirements for the installation of the products in accordance with the Specifications. Otherwise it may cause malfunction.

**Note:** Do not install the product in any location where oil, dust, iron powder, chemicals, or hydrogen sulphide may occur or affect the product. It may cause damage to equipment.

## Section 1 – INTRODUCTION

EVA-UB4 series base is detector base which is designed to be used with the model EVA-PY3, EVA-PYH3, EVA-H3, EVA-H3-H, EVA-PY, EVA-PYH, EVA-DPH, EVA-H2, EVA-H2-H, EVCA-P, and EVCA-PY detector series heads. The series includes EVA-UB4, which is 4 inch standard base, and EVA-UB4-6, which is 6 inch standard base.

The terminals of the base are used depending on the detector heads.

12 – 20 AWG field wire can be connected to the terminals.


EVA-UB4 is mounted to a 3-1/2" octagonal electrical box.

EVA-UB4-6 is mounted to a 3-1/2" and 4" octagonal electrical box, or 4" square electrical box. EVA-UB4-6 can be also used to cover larger opening around an electrical box.


## Section 2 – TERMINALS

EVA-UB4 / EVA-UB4-6 are supplied with 4 terminals as standard. The terminals of the bases are configured as the table below:

Terminal	Description	
	Analog detector	Conventional detector
1	SLC positive	IDC negative
3	Not used	IDC positive
5	Not used	Not used
6	SLC negative	IDC negative

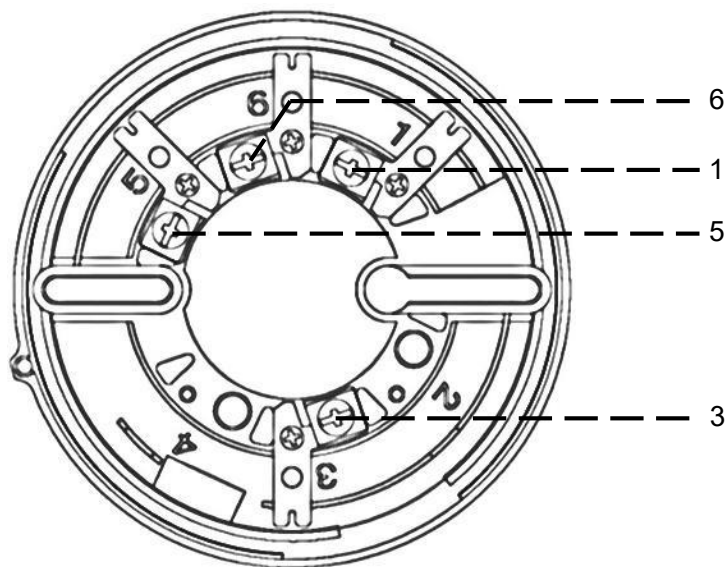


**Figure 1: Position of terminals (EVA-UB4)**

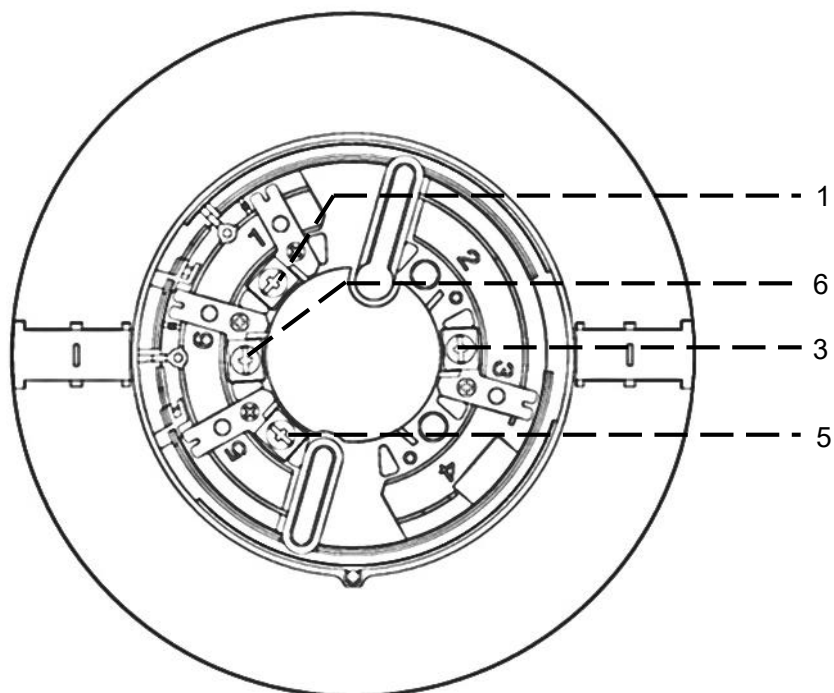


**Figure 2: Position of terminals (EVA-UB4-6)**

**Section 3 – DIMENSIONS**

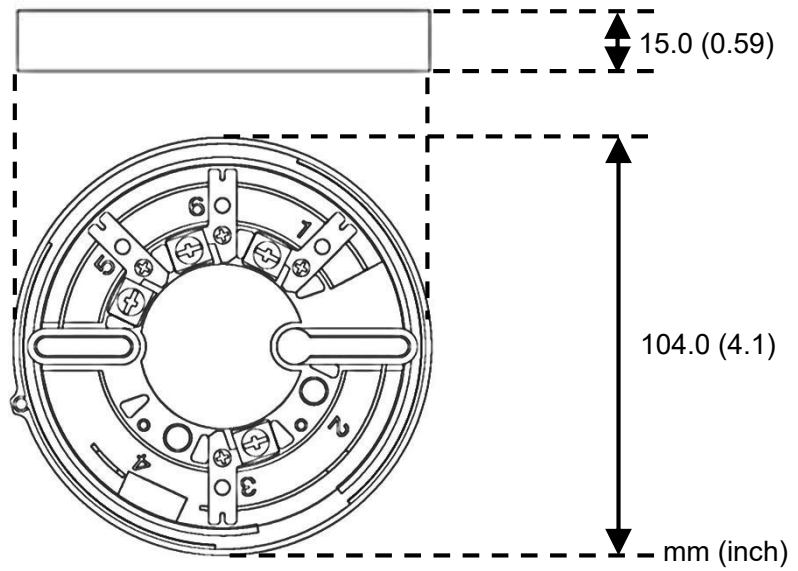

**Figure 3: Dimension of EVA-UB4**

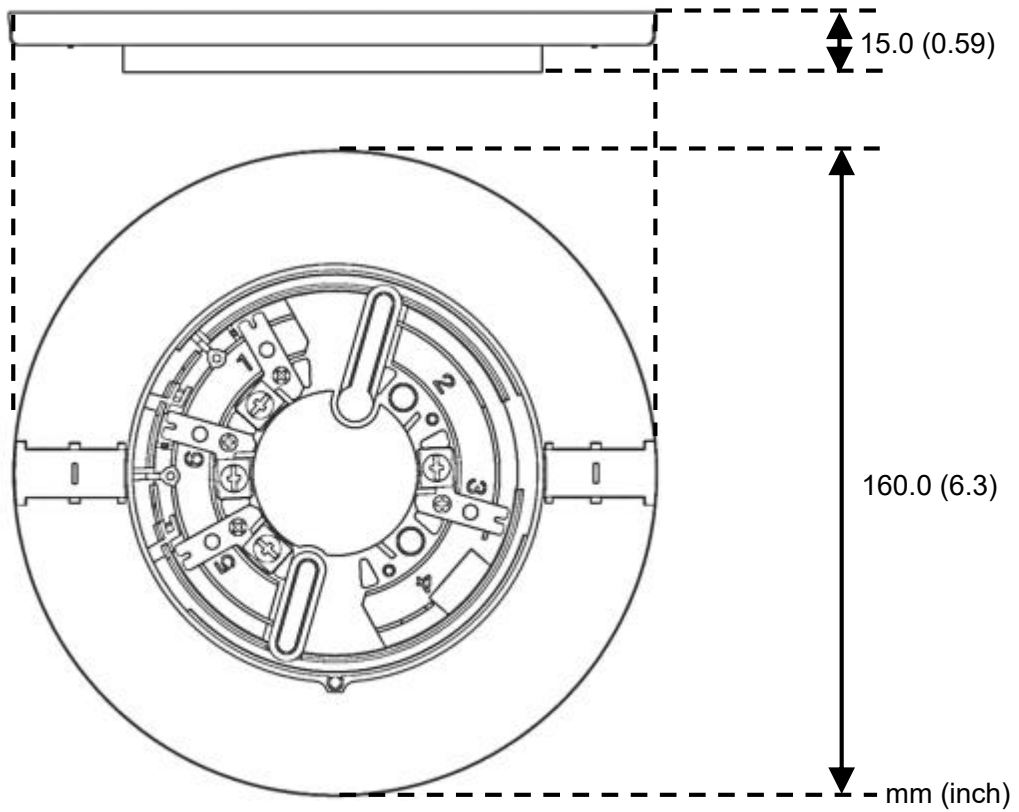

**Figure 4: Dimension of EVA-UB4-6**

## Section 4 – DETECTOR MODELS

EVA-UB4 / EVA-UB4-6 are available for use with the EVA series detectors. It is important to use the correct detector for each application. The standard range of detectors available is as follows:

Model	Description	Standard
EVA-PY3	Analog addressable photoelectric smoke detector	UL268 7th edition
EVA-PYH3	Analog addressable combination photoelectric smoke and heat detector 57°C (135°F) with 8.3°C (15°F) / min rate of rise	UL268 7th edition and UL521
EVA-H3	Analog addressable heat detector 57°C (135°F) with 8.3°C (15°F) / min rate of rise	UL521
EVA-H3-H	Analog addressable heat detector 83°C (181.4°F ) high temperature	UL521
EVA-PY	Analog addressable photoelectric smoke detector	UL268
EVA-PYH	Analog addressable combination photoelectric smoke and heat detector 57°C (135°F) with 8.3°C (15°F) / min rate of rise	UL268 and UL521
EVA-H2	Analog addressable heat detector 57°C (135°F) with 8.3°C (15°F) / min rate of rise	UL521
EVA-H2-H	Analog addressable heat detector 83°C (181.4°F ) high temperature	UL521
EVA-DPH	Analog addressable combination photoelectric smoke (dual wave length) and heat detector 57°C (135°F) with 8.3°C (15°F) / min rate of rise	UL268 and UL521
EVCA-P(-Z)	Conventional photoelectric smoke detector	UL268
EVCA-PY	Conventional photoelectric smoke detector	UL268 7th edition

## Section 5 – GENERAL OPERATION

EVA-UB4 / EVA-UB4-6 mounting bases are used to connect field wiring to the detector head. There are no electronics in the mounting bases.

## Section 6 – INSTALLATION

The product must be installed in accordance with the applicable NFPA standards, local codes and jurisdictional authorities. Failure to follow these instructions may result in failure of the detector to report an alarm condition.

**Note:** NITTAN COMPANY, LIMITED is not responsible for the product which is improperly installed, maintained or tested.

EVA-UB4 is designed to be mounted to 3-1/2" octagonal electrical box. Meanwhile EVA-UB4-6 is designed to be mounted to 3-1/2" and 4" octagonal electrical box, and 4" square electrical box.

Before installing the product, check the continuity, polarity and insulation resistance of all wiring. Check that siting is in accordance with the site system drawings and conforms to all applicable local codes such as NFPA 72.


In normal use, the **EVA-UB4 / EVA-UB4-6** will be installed at ceiling level or wall position. Please refer to specific detector instruction manual for details. Pass the field wiring through the cable opening in the center and from the rear of the base. Install the base to the electrical box with screws via the base mounting holes. Connect the field wiring to the base terminals, as detailed in figure 8 and 9, making sure the wiring does not obstruct mounting of the detector head. Install the detector head by inserting it into the base and turning clockwise until the notch in the detector rim aligns with base locking screw. To avoid unauthorized removal, turn the locking screw counterclockwise until the screw extends out about 4 mm (3/16") from the rim of the base (See Figure 7).

**Note:** If the detector is installed on a high ceiling where a tool (ladder, etc.) is needed, it is not recommended to use the locking screw.




Smoke and heat detectors are not to be used with detector guards unless the combination has been evaluated and found suitable for that purpose.

---

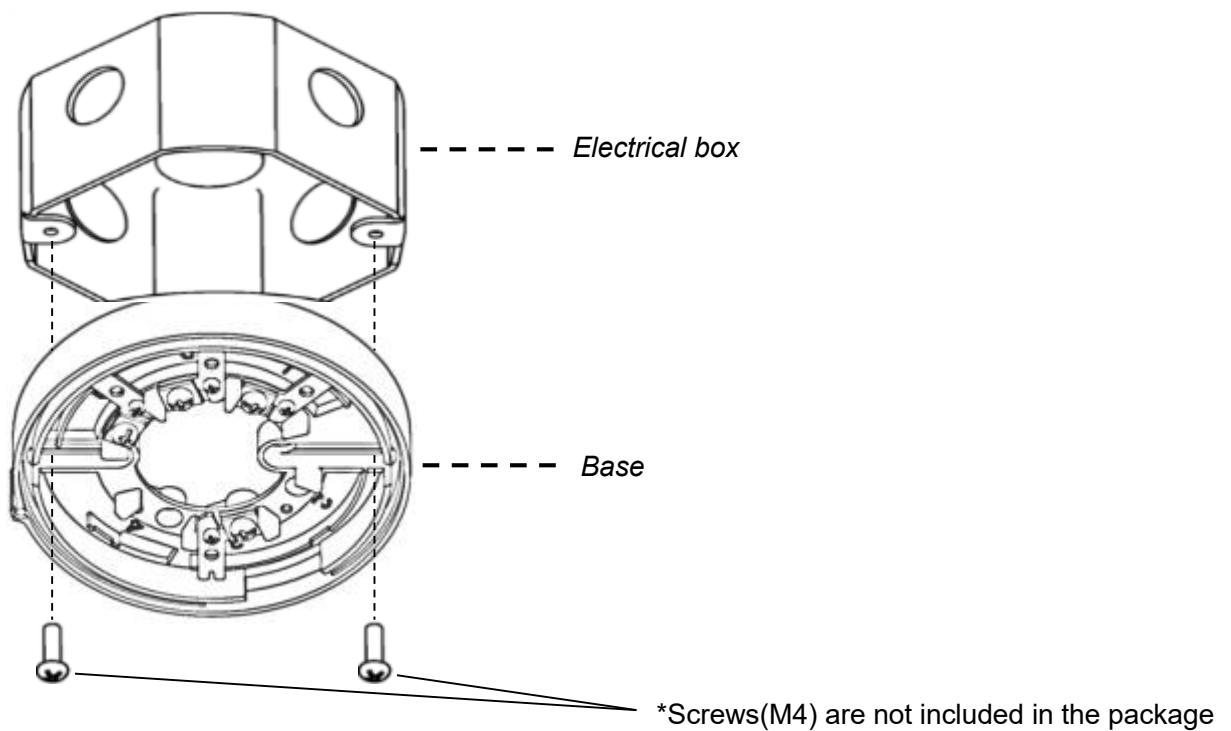


**Figure 5: Installation to an electrical box for EVA-UB4**

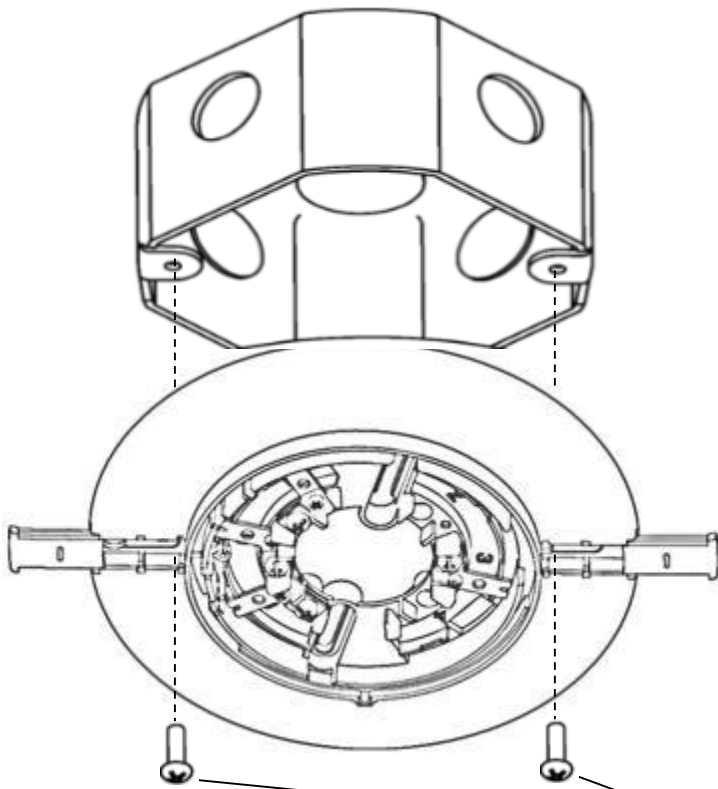

\*Screws(M4) are not included in the package

**Figure 6: Installation to an electrical box for EVA-UB4-6**

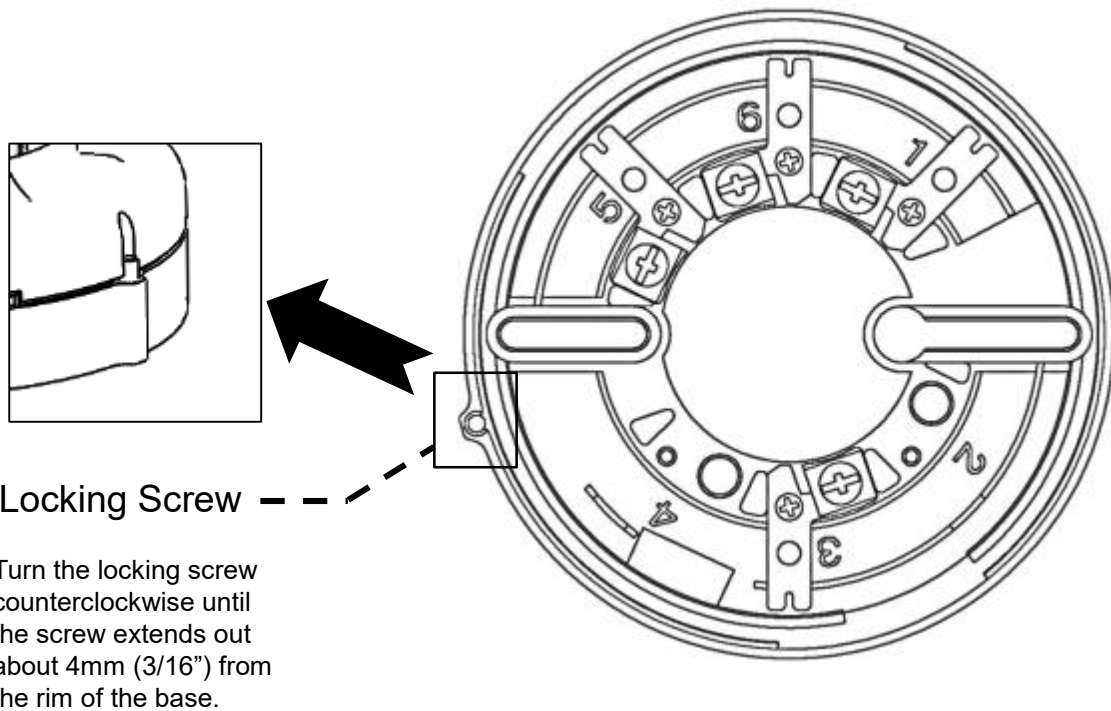


Locking Screw

Turn the locking screw counterclockwise until the screw extends out about 4mm (3/16") from the rim of the base.

**Figure 7: Position of locking screw**

**Section 7 – CONNECTIONS**


Connect to analog detector EVA-PY3, EVA-PYH3, EVA-H3, EVA-H3-H, EVA-PY, EVA-PYH, EVA-H2, EVA-DPH or EVA-H2-H.

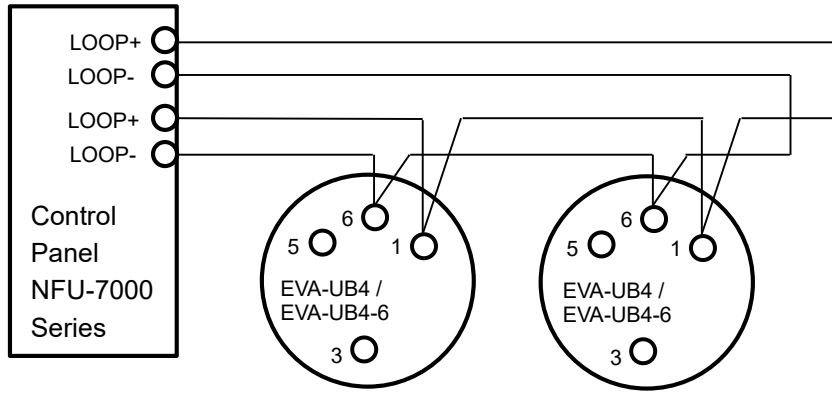

**Figure 8: Connection to control panel NFU-7000 series**

To UL Listed control panel NFU-7000 series


Connect to UL Listed conventional detector EVCA-P(-Z) or EVCA-PY for Class A wiring.

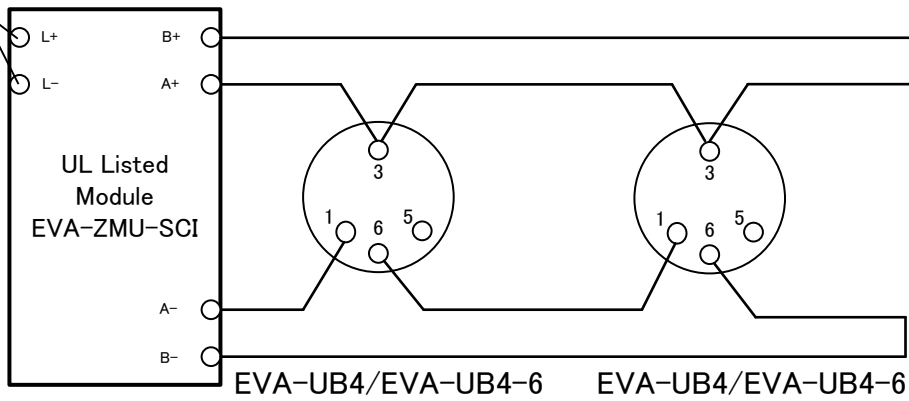

**Class A wiring**

To UL Listed control panel NFU-7000 series

Connect to UL Listed conventional detector EVCA-P(-Z) or EVCA-PY for Class B wiring

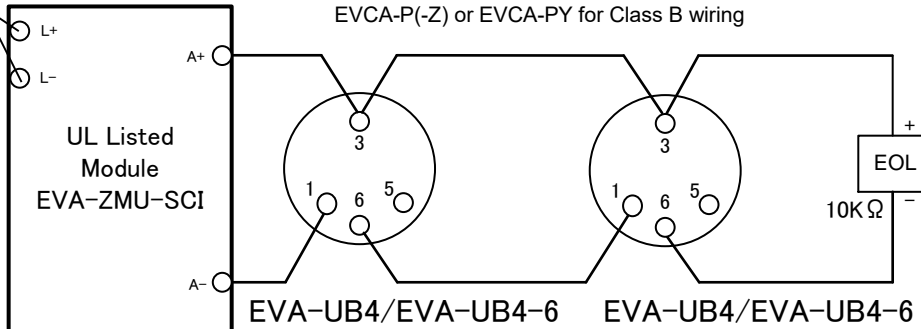

**Class B wiring**

**Figure 9: Connection of conventional detector**

---

⚠ CAUTION

Use cable AWG12-20 for wiring. Do not connect different gauge cables at one terminal in order to prevent loosening.


---

---

⚠ CAUTION

Do not connect cables in reverse polarity. Failure to connect the polarity correctly could result in damage to other equipment.

---

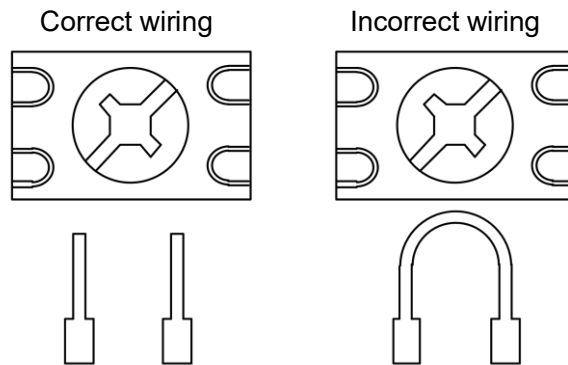

**Figure 10: Connection to terminals**

---

⚠ CAUTION

For system monitoring – For terminals do not use looped wire under terminals. Break wire run to provide monitoring of connections.

---

## Section 8 – SPECIFICATION

UL Ambient Installation Temperature Range	0°C (32°F) to 65.6°C (150°F)
Storage Temperature Range	-20°C (-4°F) to 60°C (140°F)
Max Relative Humidity	Up to 95%RH, non-condensing
Environment	Indoor dry use only
Terminal	AWG12-20
Dimensions: EVA-UB4 / EVA-UB4-6	Φ104mm x 15mm H (Φ4.1" x 0.59" H) / Φ160mm x 15mm H (Φ6.3" x 0.59" H)
Weight: EVA-UB4 / EVA-UB4-6	Approximately 60g (2.1 ounces) / Approximately 95g (3.3 ounces)
Conformity	UL268 and UL521

FOR WARRANTY SERVICE, RETURN TO:  
OVERSEAS BUSINESS DIVISION  
NITTAN COMPANY, LIMITED  
1-54-5 SASAZUKA, SHIBUYA-KU, TOKYO, 151-8535, JAPAN  
<https://www.nittan.com/english>

## Section 9 – WARRANTIES

9.1 Nittan warrants to the customers that:

- (a) all products supplied hereunder will be of merchantable quality and will comply with any specification agreed between Nittan and customer.
- (b) it is not aware of any rights of any third party in the market which would or might render the sale of the products, or the use of any of the trade marks on or in products, or the use of any of the trade marks on or in relation to the products, unlawful.

9.2 In the event of any breach of the Nittan's warranty in Clause 9.1(a) whether by reason of defective materials, production faults or otherwise, Nittan's liability shall be limited to:

- (a) replacement of the products in question; or
- (b) at the Nittan's option, repayment of the price where this had been paid.  
And the warranty period is three (3) years from the shipment from Nittan's factory.

9.3 Notwithstanding anything to the contrary in this warranty terms, Nittan shall not be liable to the customer by reason of any representation or implied warranty, condition or other term or any duty at common law, or under the express terms of this warranty terms, for any consequential loss or damage whether for loss of profit or otherwise and whether occasioned by the negligence of Nittan or its employees or agents or otherwise, arising out of or in connection with any act or omission of Nittan relating to manufacture or supply of the products, or their use by any customer.

9.4 Customer shall indemnify Nittan against all loss, damages, liabilities, costs and expenses which Nittan may suffer or incur as a result of or in connection with any breach by customer of this warranties terms or any laws or regulations of any jurisdiction or any rules of any governing authorities.